

In the water loss audit submitted to the Texas Water Development Board for the time period of Jan-Dec 2023, our system lost an estimated **80,767,096 gallons** of water. If you have any questions about the water loss audit please call 713-662-8150.

DROUGHT CONTINGENCY AND WATER CONSERVATION PLAN

The City of Bellaire has an updated Drought Contingency Plan should a drought or other event occur. The City Manager or her designee, shall monitor water supply and/or demand conditions on a daily basis and in accordance with the triggering criteria set forth in this Plan, shall determine that a mild, moderate, severe, critical, emergency or water shortage conditions exists and shall implement public notification procedures, by means of newspaper publications, public service announcements, publicly posted signs, and announcements on the City's website bellairetx.gov.

Here are the updated stages of Water Shortage Conditions :

- **Stage 1 - MILD** - customer voluntary water conservation restrictions; goal is a **five percent (5%)** reduction in system demand.
- **Stage 2 - MODERATE** - customer required compliance and restrictions on non-essential water uses; goal is a **ten percent (10%)** reduction in system demand.
- **Stage 3 - SEVERE** - customer required compliance and restrictions on non-essential water uses; goal is a **twenty percent (20%)** reduction in system demand; mandatory water use restrictions for demand reduction, under enforcement of penalty for violations.
- **Stage 4 - CRITICAL** - customer required compliance and restrictions on non-essential water uses; goal is a **thirty percent (30%)** reduction in system demand; mandatory water use restrictions for demand reduction, under enforcement of penalty for violations.
- **Stage 5 - EMERGENCY** - customer required compliance and restrictions on non-essential water uses; goal is a **thirty-five percent (35%)** reduction in system demand; mandatory water use restrictions for demand reduction, under enforcement of penalty for violations.

Some helpful tips to conserve water:

- Do not water lawns daily. (*Do not overwater or allow water to run off to street; change timers on sprinklers to water after midnight.*)
- Check your swimming pool to make sure it is not overfilling.
- Check for and repair detectable water leaks as soon as possible.
- Keep showers under five minutes.
- Turn water off while brushing teeth.
- Replace older-model showerheads and faucets.
- Limit washing vehicles.

Your cooperation will help ensure that water supplies are maintained at maximum levels and prevent the need to impose more restrictive measures to conserve water.

For more information and details on the City's Drought Contingency Plan, go to bellairetx.gov/ccr

OUR DRINKING WATER IS REGULATED: This is your water quality report for January 1 to December 31, 2024. This report is a summary of the quality of the water we provide our customers. The analysis was made by using the data from the most recent U. S. Environmental Protection Agency (EPA) required tests and is presented in the attached pages. We hope this information helps you become more knowledgeable about what's in your drinking water.

About this report: TCEQ completed an assessment of your source water and results indicate that some of your sources are susceptible to certain contaminants. The sampling requirements for your water system is based on this susceptibility and previous sample data. Any detections of these contaminants will be found in this Consumer Confidence Report. For more information on source water assessments and protection efforts at our system contact the City of Bellaire (713-662-8150).

City of Bellaire

Annual Drinking Water Quality Report 2024


Public Participation Opportunities:

Public input concerning the City of Bellaire water system may be made at:

5808 S. Rice Ave
Bellaire, TX
Monday - Friday
9:00 am - 3:00 pm
Contact: City of Bellaire
713-662-8150

En Espanol:

Este informe incluye informacion importante sobre el agua potable. Si tiene preguntas o comentarios sobre este informe en espanol, favor de llamar al tel. 713-662-8170 para hablar con una persona bilingue en espanol.

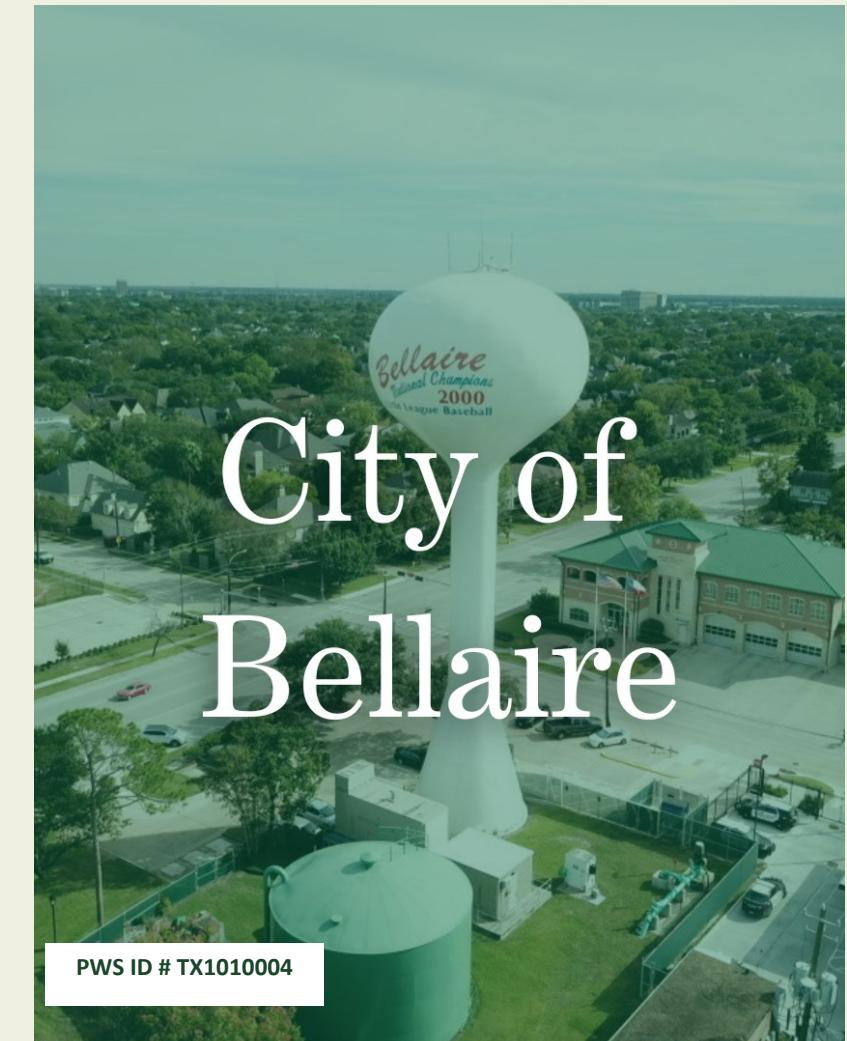

City of Bellaire

PWS ID # TX1010004

OUR DRINKING WATER IS RATED SUPERIOR

CITY OF HOUSTON WATER IS RATED SUPERIOR

MEETS OR EXCEEDS ALL FEDERAL (EPA) DRINKING WATER REQUIREMENTS

Your Drinking Water

The sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pickup substances resulting from the presence of animals or from human activity.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline at (800) 426-4791.

Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants, such as salt and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems.
- Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of certain contaminants in water provided by public water systems. FDA regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

Contaminants may be found in drinking water that may cause taste, color, or odor problems. These types of problems are not necessarily causes for health concerns. For more information on taste, odor, or color of drinking water, please contact the City of Bellaire.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City of Bellaire is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

DEFINITIONS AND ABBREVIATIONS

Maximum Contaminant Level (MCL): The highest permissible level of a contaminant in drinking water. MCLs are set as close to the MCLG as feasible using the best available treatment technology.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected health risk. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contamination.

Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Picocuries per liter (pCi/L): A measure of radioactivity.

Parts per million (ppm): The equivalent of milligrams per liter (mg/L) is analogous to 1 minute in 2 years.

Parts per billion (ppb): The equivalent of micrograms per liter (ug/L) is analogous to 1 minute in 32 years.

NA: Not Applicable.

Source of Drinking Water

Three-Year Public Water System Inspection: A comprehensive inspection of all water system facilities was conducted as part of the required three-year review by TCEQ. This inspection helps ensure ongoing compliance with state regulations and the continued delivery of safe, reliable drinking water. The result of this inspection was satisfactory and the City of Bellaire was given the continued rating of "Superior".

Where Do We Get Our Drinking Water?

The City of Bellaire provides 52% Surface Water supplied by the City of Houston's East Water Purification Plant 1 & 2 and Southwest Repump, and 48% Ground Water from the Evangeline Aquifer located in Harris County. A Source Water Susceptibility Assessment for your drinking water sources is currently being updated by the Texas Commission on Environmental Quality. This information describes the susceptibility and types of constituents that may come into contact with your drinking water source based on human activities and natural conditions. The information contained in the assessment allows us to focus source water protection strategies. Some of this source water assessment is available on Texas Drinking Water Watch at <http://dww.tceq.state.tx.us/DWW/>. For more information on source water assessments and protection efforts at our system, please contact us.

Violations Notice:

Disinfectant Level Quarterly Operating Report (DLQOR): Chlorine—10/01/2024—12/01/2024—We failed to test our drinking water for the contaminant and period indicated. Because of this failure, we cannot be sure of the quality of our drinking water during the period indicated. We failed to submit our drinking water report in a timely manner for the contaminant and period indicated.

Lead and Copper Rule—12/30/2024—We failed to provide the results of lead tap water monitoring to the consumers at the location water was tested. These were supposed to be provided no later than 30 days after learning the results.

Additional Notices:

UCMR-5

The City of Bellaire is currently participating in the UCMR-5 (Unregulated Contaminant Monitoring rule) and is still on-going through November of 2025. We are required to report UCMR results in the CCR when unregulated contaminants are found (i.e., measured at or above minimum reporting levels [MRLs]), and must report the average and range of the monitoring results for the report year. Please find data at the bottom of table.

Lead Service Line Inventory

We have developed a service line inventory, listing what the water supply line material is. To access the inventory for your address, please visit 5808 S. Rice Ave. Bellaire, Tx. 77401 and/or contact John Trevino, Assistant Director of Public Works 713-662-8174.

Regulated Contaminants								
			City of Bellaire		City of Houston			
Inorganic Contaminants	YEAR	MCL	MCLG	HIGHEST LEVEL	RANGE	RANGE	VIOLATION	LIKELY SOURCE OF CONTAMINATION
				DETECTED	Min - Max	AVERAGE		
Arsenic (ppb)								
	2023	10	0	4.3	0 - 4.3	NA	NA	N
While your drinking water meets EPA standards for Arsenic, it does contain low levels of Arsenic. EPA's standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. EPA continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.								
Barium (ppm)	2023	2	2	0.151	0.051 - 0.151	0.0465	0.0465 - 0.0566	N
Fluoride (ppm)	2023	4	4	0.66	0.3 - 0.66	0.21	0.20 - 0.22	N
Nitrate (ppm)	2024	10	10	0.38	0 - 0.38	0.48	0.05 - 0.91	N
Cyanide (ppm)	2024	0.2	0.2	0.13	0 - 0.130	0.14	0.09 - 0.20	N
Thallium (ppm)	2023	0.002	0.0005	NA	NA	0.0001	0 - 0.0003	N
Turbidity								
	YEAR	MCL	LOWEST MONTHLY % <0.3 NTU			ANNUAL MAX		VIOLATION
Turbidity (NTU)	2024	0.3	100%			0.28		N
Radioactive Contaminants								
Beta/photon emitters (pCi/L)	2023	50	0	5.6	0 - 5.6	5.1	4.8 - 5.3	N
Combined Radium 226-228 (pCi/L)	2023	5	0	1.35	1.35 - 1.35	1.5	1.5 - 1.5	N
Gross alpha (pCi/L)	2023	15	0	6.6	0 - 6.6	NA	NA	N
Synthetic Organic Contaminants								
Atrazine (ppb)	2024	3	3	0.12	0 - 0.12	0.16	0.15 - 0.17	N
Simazine (ppb)	2024	4	4	0.09	0 - 0.09	0.1	0.07 - 0.12	N
Disinfection By-products								
Total Trihalomethanes (TTHMs) (ppb)	2024	80	None	40	0 - 48.8	NA	NA	N
Halogenated Acids (HAAs) (ppb)	2024	60	None	34	0 - 49.3	NA	NA	N
Disinfectant								
Chloramines and Chlorine (ppm)	2024	4	4	3.3	0.5 - 4.1	NA	NA	Y
TCEQ Reporting Violation – DLQOR Late Submittal (October–December 2024): The Disinfection Level Quarterly Operating Report (DLQOR) for the period of October through December 2024 was submitted late, resulting in a reporting violation with the Texas Commission on Environmental Quality (TCEQ). This violation was related strictly to the timeliness of the report submission. There were no issues with disinfection levels or water quality during this time, and all monitoring requirements were met. The water remained safe to drink, and there was no impact on public health.								
Some people who use water containing chlorine well in excess of the MRDL could experience irritating effects to their eyes and nose. Some people who drink water containing chlorine well in excess of the MRDL could experience stomach discomfort.								
Total Coliform	YEAR	Maximum Contaminant Level Goal	Total Coliform Maximum Contaminant Level	Highest No. of Positive	Fecal Coliform or E. Coli Maximum	Total No. of Positive E. Coli or Fecal Coliform Samples	Violation	LIKELY SOURCE OF CONTAMINATION
	2024	0	1 positive monthly sample.	1	0	0	N	Naturally present in the environment.
Total Coliform bacteria are used as indicators of microbial contamination of drinking water because testing for them is easy. While not disease causing organisms themselves, they are often found in association with other microbes that are capable of causing disease. Coliform bacteria are more hardy than many disease causing organisms; therefore, the absence from water is a good indicator that the water is microbiologically safe for human consumption.								
Lead and Copper	YEAR	MCLG	ACTION LEVEL	90th PERCENTILE	# of SITES OVER AL	AVERAGE	RANGE	VIOLATION
Lead (ppb)	2024	0	15	5.9	1	1.1	ND - 1.2	N
Copper (ppm)	2024	1.3	1.3	0.288	0	0.0012	ND - 0.0023	N
TCEQ Reporting Violation - Lead Consumer Notice Late Submittal (December 2024 - February 2025): Lead tap water monitoring results were not provided to consumers at the sample locations within the required 30-day period. This reporting violation began on December 30, 2024, and was resolved on February 4, 2025. Lead levels remained within regulatory limits, and there was no impact to water quality or public health.								
Lead and Copper Service Line Inventory: A complete lead and copper service line inventory was submitted to TCEQ in October 2024. The inventory identifies the material of each service line, including copper, PVC, and high-density polyethylene (HDPE). This information is available to the public upon request.								
Unregulated Monitored Contaminants								
Lithium (ug/L)	2024	Average	23.8	Range	13.7 - 33.9	Lithium is not currently regulated in drinking water by the EPA or state agencies. It is being monitored under the EPA's UCMR for data collection only. The EPA's Minimum Reporting Level (MRL) for lithium is 9 ug/L (parts per billion).		